





# 2 CHANNEL STEEL SKIRTING DUCT Catalogue No: S100.25

## **Standard Surface Mounted**

## ACCESSORIES


- Economical
- No maintenance (all metal)
- Accepts standard power and telephone skirting type accessories

MAIN FEATURES

- Cover plates simply snap in place
- Single power outlet mounting kit S100.25/SP.
- Double power outlet mounting kit S100.25/DP.
- 3. Telephone outlet mounting kit S100.25/T.
- 4. Data outlet mounting kit S100.25/D.
- 5. End cover plate with fixing screws S100.25/E.
- Right angle external corner S100.25/C.

## NOTES

- Recommended fixing centres 800mm max.
- Standard duct in 2.4 metre lengths
- Medium voltage cables in duct to be double insulated type to save earth bonding covers and body.
- Available in 130 powder coat colours

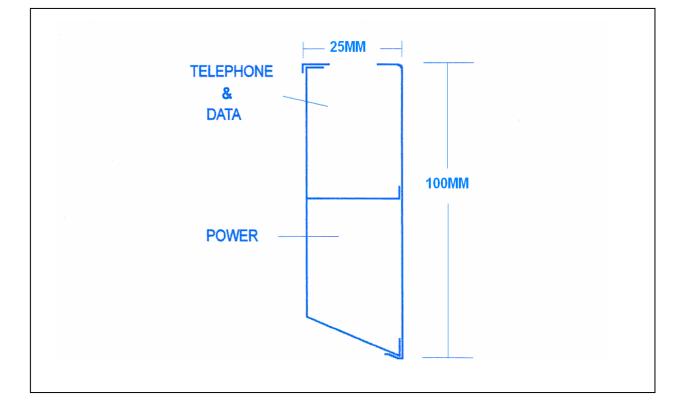

## S100.25 Skirting Duct

### **GENERAL**:

The contractor shall supply and install the skirting duct system where shown on the drawings. The ducting system shall be complete with all factory made accessories.

### **COMPLIANCE:**

The Contractor shall ensure that the entire skirting wiring duct installation complies with the requirements of the local supply Authority and Austel. All ducting shall be earthed.

### TYPE:

The skirting wiring duct shall:-

- \* Be of steel fabrication.
- \* Be a minimal size of 100mm x 25mm.
- \* Have two (2) segregated wiring compartments for phone/data and power cabling
- \* Be suitable for surface mounting
- \* Have front cover plates of sheet steel either powdercoated a nominated colour or affixed with a bonded vinyl film of selected colour similar to Marviplate.
- \* Have a 50mm channel section overhang for alignment of adjoining duct body.
- \* The duct shall be equal to Ductall Systems S100.25 skirting.

#### **INSTALLATION:**

The skirting wiring duct shall be fixed to walls alternatively at the top and bottom of the duct at maximum centres of 1000mm. All joints (butt, corner and angled) shall be neatly made in a tradesman like fashion with no visible gaps.

Supply and install wiring access via conduits within stud walls, etc. and associated draw wires, to all duct sections throughout this installation. Access shall be separate for each duct channel to maintain electrical isolation.