




3 Channel Steel Skirting Duct

Standard Surface Series



CATALOGUE NO: S100.25.3

- ❖ Economical
- ❖ Wiring Installation Costs Slashed
- ❖ Easy to Install
- ❖ Standard Colour – Black Versiclad
(other colours on request – including the Dulux
Powder Coat Colour Range)

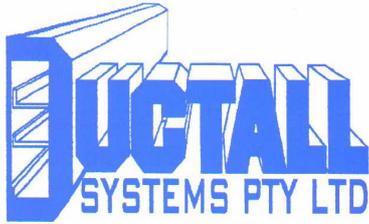

3 CHANNEL STEEL SKIRTING DUCT

Catalogue No: S100.25.3

Standard Surface Mounted

MAIN FEATURES


- Economical
- No maintenance (all metal)
- Accepts standard power and telephone skirting type accessories
- Cover plates simply snap in place

ACCESSORIES

1. Single power outlet mounting kit – S100.25.3/SP.
2. Double power outlet mounting kit – S100.25.3/DP.
3. Telephone outlet mounting kit – S100.25.3/T.
4. Data outlet mounting kit – S100.25.3/D.
5. End cover plate with fixing screws – S100.25.3/E.
6. Right angle external corner – S100.25.3/C.

NOTES

- Recommended fixing centres 800mm max.
- Available in 130 powder coat colours
- Standard duct in 2.4 metre lengths
- Medium voltage cables in duct to be double insulated type to save earth bonding covers and body.

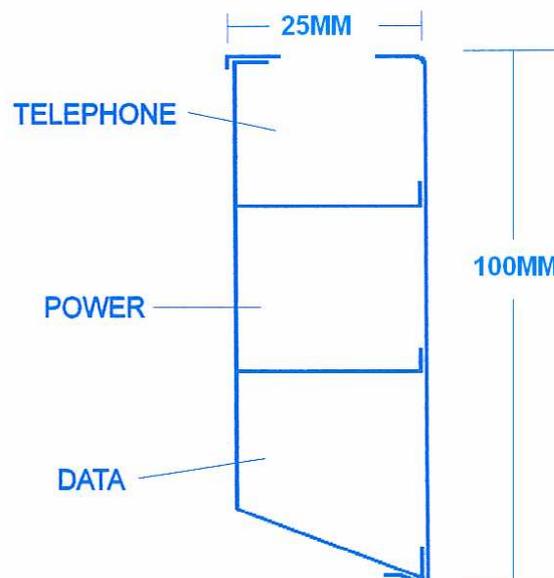

S100.25.3 Skirting Duct

GENERAL:

The contractor shall supply and install the skirting duct system where shown on the drawings. The ducting system shall be complete with all factory made accessories.

COMPLIANCE:

The Contractor shall ensure that the entire skirting wiring duct installation complies with the requirements of the local supply Authority and Austel. All ducting shall be earthed.

TYPE:

The skirting wiring duct shall:-

- * Be of steel fabrication.
- * Be a minimal size of 100mm x 25mm.
- * Have three (3) segregated wiring compartments for phone, power and miscellaneous cabling. The power channel shall be the middle compartment in the duct.
- * Have recesses for fishplates or dowel to align duct sections at joints.
- * Have front cover plates of sheet steel either powdercoated a nominated colour or affixed with a bonded vinyl film of selected colour similar to Marviplate.
- * Have a 50mm channel section overhang for alignment of adjoining duct body.
- * The duct shall be equal to Ductall Systems S100.25.3 skirting.

INSTALLATION:

The skirting wiring duct shall be fixed to walls alternatively at the top and bottom of the duct at maximum centres of 1000mm. All joints (butt, corner and angled) shall be neatly made in a tradesman like fashion with no visible gaps.

Supply and install wiring access via conduits within stud walls, etc. and associated draw wires, to all duct sections throughout this installation. Access shall be separate for each duct channel to maintain electrical isolation.