



## 3 Channel Centre Line Steel Skirting Duct


### Standard Surface Series

ALL SERVICES ON THE **CENTRE LINE**



CATALOGUE NO: S200.40.3CL

- ❖ Wiring installation costs slashed
- ❖ Large channel capacity
- ❖ Easy to install
- ❖ Full clip-on Marviplate Cover Plates
- ❖ Fully Enclosed Steel GPO Mounting Kits For Power/Data Shielding

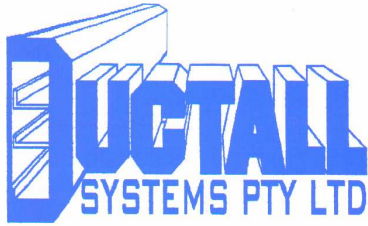

---

## 3 CHANNEL CENTRE LINE STEEL SKIRTING DUCT

Catalogue No: S200.40.3CL

---

### Standard Surface Mounted

---

#### MAIN FEATURES

- Easy to install (no measuring from floor)
- No maintenance (all metal)
- Accepts standard power and telephone skirting type accessories
- Cover plates simply clip in place


#### ACCESSORIES

1. Single power outlet mounting kit – S200.40.3CL/SP.
2. Double power outlet mounting kit – S200.40.3CL/DP.
3. Telephone outlet mounting kit – S200.40.3CL/T.
4. Data outlet mounting kit – S200.40.3CL/D.
5. End cover plate with fixing screws – S200.40.3CL/E.
6. Right angle external corner – S200.40.3CL/C.

---

#### NOTES

- Recommended fixing centres 800mm max.
- Available in 130 powder coat colours
- Standard duct in 2.4 metre lengths
- Medium voltage cables in duct to be double insulated type to save earth bonding covers and body.

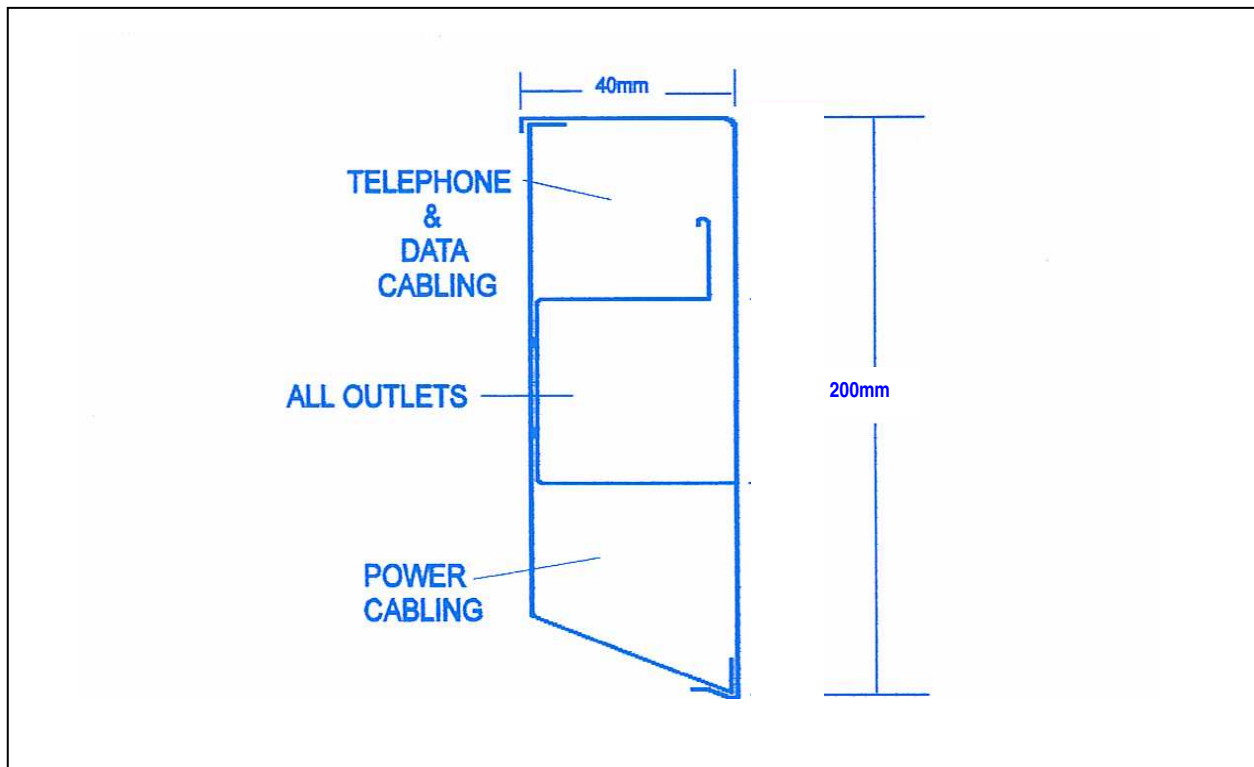

## **S200.40.3CL Skirting Duct**

### **GENERAL:**

The contractor shall supply and install the skirting duct system where shown on the drawings. The ducting system shall be complete with all factory made accessories.

### **COMPLIANCE:**

The Contractor shall ensure that the entire skirting wiring duct installation complies with the requirements of the local supply Authority and Austel. All ducting shall be earthed.

### **TYPE:**

The skirting wiring duct shall:-

- \* Be of sheet metal fabrication.
- \* Be a minimal size of 200mm x 40mm.
- \* Have three (3) segregated wiring compartments for phone/data cabling to be run in top channel and the power cabling to be run in the middle channel with all services exiting the duct in the middle channel.
- \* Have recesses for fishplates or dowel to align duct sections at joints.
- \* Have front cover plates of sheet steel either powdercoated a nominated colour or affixed with a bonded vinyl film of selected colour similar to Marviplate.
- \* Have a 50mm channel section overhang for alignment of adjoining duct body.
- \* The duct shall be equal to Ductall Systems S200.40.3CL skirting.

### **INSTALLATION:**

The skirting wiring duct shall be fixed to walls alternatively at the top and bottom of the duct at maximum centres of 1000mm. All joints (butt, corner and angled) shall be neatly made in a tradesman like fashion with no visible gaps.

Supply and install wiring access via conduits within stud walls, etc. and associated draw wires, to all duct sections throughout this installation. Access shall be separate for each duct channel to maintain electrical isolation.