


3 Channel Donald Series
Steel/Aluminium Skirting Duct with Rounded Top

Standard Surface Series



CATALOGUE NO: SA150.37.3RT

- ❖ Economical
- ❖ Wiring Installation Costs Slashed
- ❖ Easy to Install
- ❖ Modern rounded top extruded aluminium front cover with galvabond steel back plate

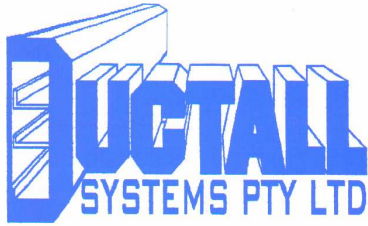

3 CHANNEL DONALD SERIES STEEL / ALUMINIUM SKIRTING DUCT WITH ROUNDED TOP Catalogue No: SA150.37.3RT

Standard Surface Mounted

MAIN FEATURES


- Easy to install (no measuring from floor)
- No maintenance (all metal)
- Accepts standard power and telephone skirting type accessories
- Cover plates simply clip in place

ACCESSORIES

1. Single power outlet mounting kit – SA150.37.3RT/SP.
2. Double power outlet mounting kit – SA150.37.3RT/DP.
3. Telephone outlet mounting kit – SA150.37.3RT/T.
4. Data outlet mounting kit – SA150.37.3RT/D.
5. End cover plate with fixing screws – SA150.37.3RT/E.
6. Right angle external corner – SA150.37.3RT/C.

NOTES

- Extruded aluminium cover comes in 3 metre lengths
- Recommended fixing centres 800mm max.
- Available in 130 powdercoated colours
- Steel back plate comes in 2.4 metre lengths
- Medium voltage cables in duct to be double insulated type to save earth bonding covers and body.

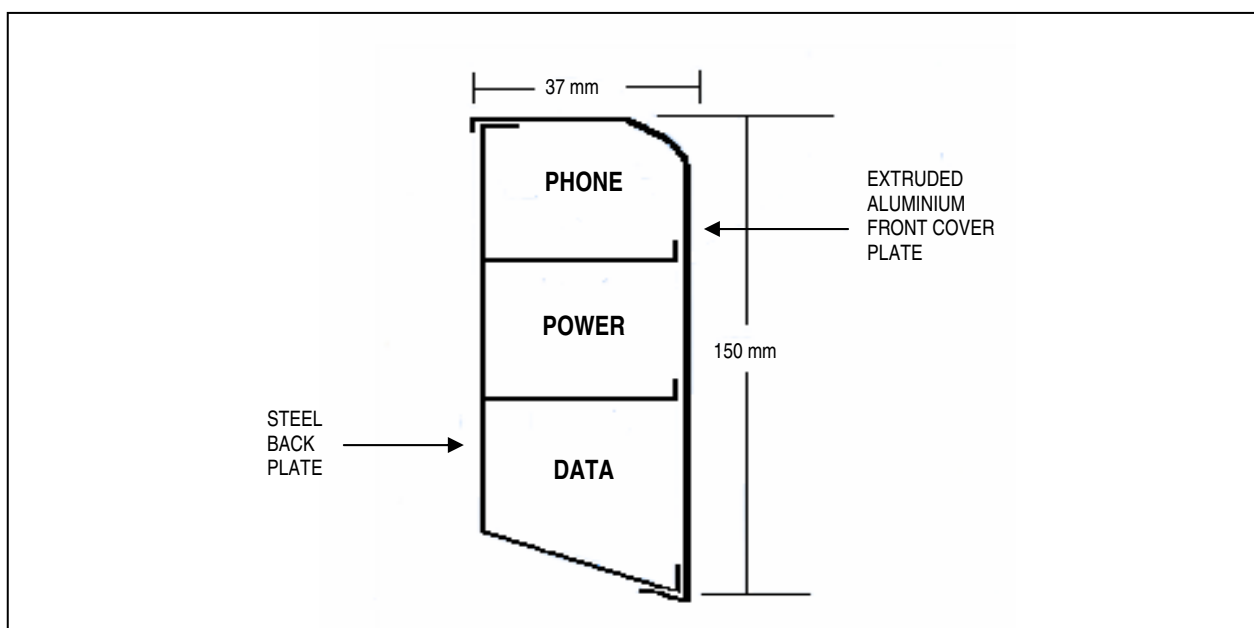

SA150.37.3RT Skirting Duct

GENERAL:

The contractor shall supply and install the skirting duct system where shown on the drawings. The ducting system shall be complete with all factory made accessories.

COMPLIANCE:

The Contractor shall ensure that the entire skirting wiring duct installation complies with the requirements of the local supply Authority and Austel. All ducting shall be earthed.

TYPE:

The skirting wiring duct shall:-

- * Be of steel metal fabrication with an extruded aluminium 'rounded top' snap on cover.
- * Be a minimal size of 150mm x 37mm.
- * Have three (3) segregated wiring compartments for phone, power and miscellaneous cabling.
- * Be suitable for surface mounting.
- * Have front cover plates of sheet steel either powdercoated a nominated colour or affixed with a bonded vinyl film of selected colour similar to Marvplate.
- * Have exposed duct body finished in baked enamel (powdercoated) of selected colour.
- * The duct shall be equal to Ductall Systems SA150.37.3RT skirting.

INSTALLATION:

The skirting wiring duct shall be fixed to walls alternatively at the top and bottom of the duct at maximum centres of 1000mm. All joints (butt, corner and angled) shall be neatly made in a tradesman like fashion with no visible gaps.

Supply and install wiring access via conduits within stud walls, etc. and associated draw wires, to all duct sections throughout this installation. Access shall be separate for each duct channel to maintain electrical isolation.